Hurricane Katrina Water Model

Landfall is Occurring

For Official Use Only!

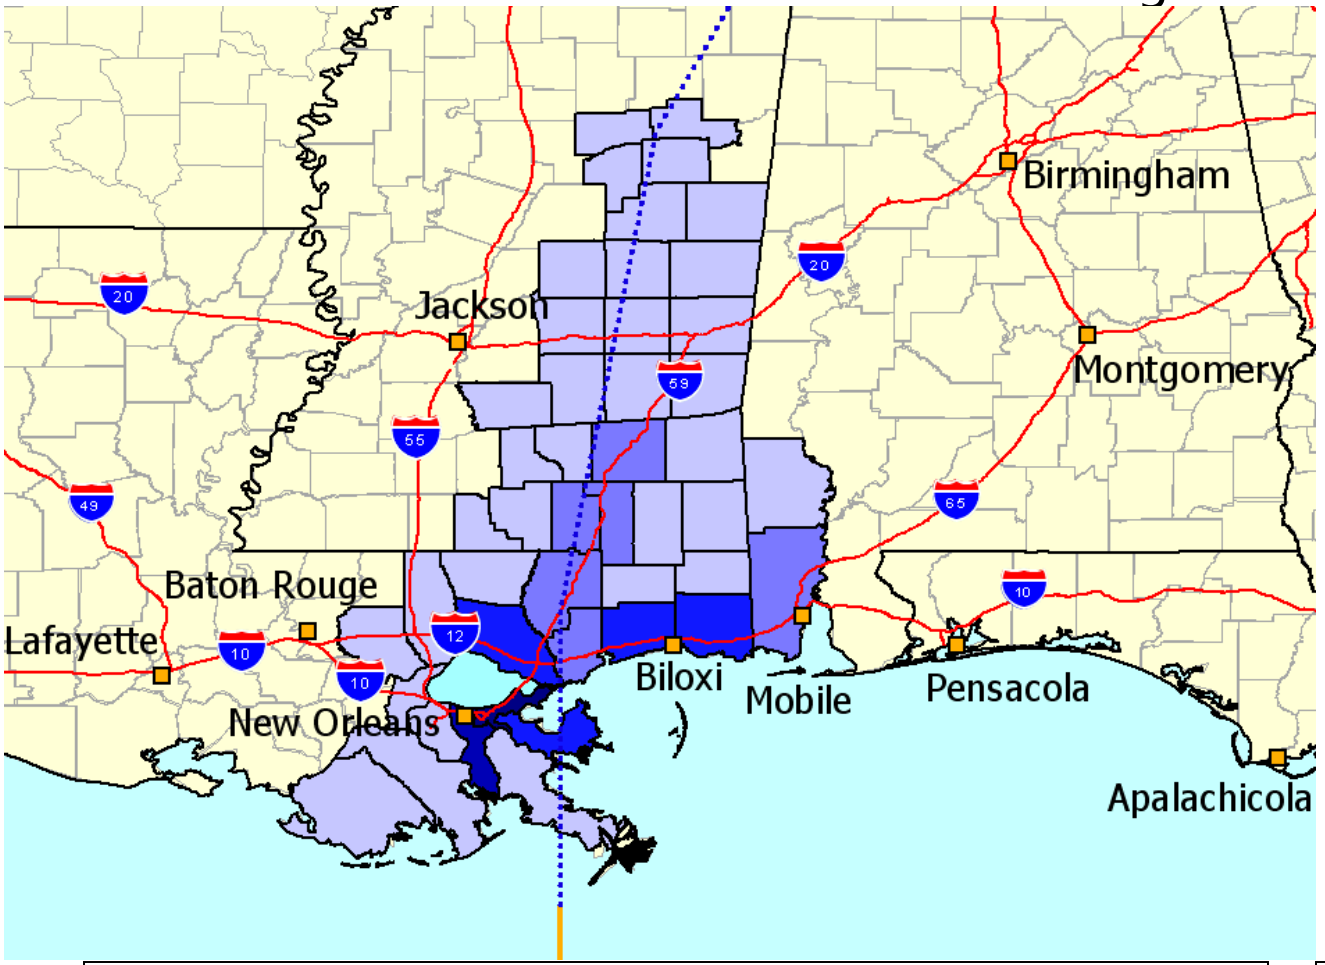

Most Probable Landfall Water Model Results

Louisiana –
27 Truckloads Day One
54 Truckloads Day Two
108 Truckloads Day Three

Mississippi –
19 Truckloads Day One
37 Truckloads Day Two
74 Truckloads Day Three

Alabama –
1 Truckloads Day One
3 Truckloads Day Two
6 Truckloads Day Three

Information provided on this page displays a Category 4 storm making landfall near New Orleans, LA. These projections are based on information from the NHC ***(0500 EDT 08/29/2005)*** forecast. The amount of water forecasted is based on Mission Guide Book requirements (3 liters per person per day) and Water SME input and represents a first day daily need.

Details about this model may be obtained at https://englink.usace.army.mil

or contact ENGLink at 1-877-936-4546

US Army Corps of Engineers

Hurricane Katrina Water Model

Generated By:
Terry Siemsen, LRL 0700 EDT 08/29/2005

Sources:
HURREVAC
LRL-DEBRIS

Hurricane Katrina Water Model

Landfall is Occurring

For Official Use Only!

Ice/Water Commodities - Trucks/Distribution Lanes Ramp-up
(Number of Trucks Each Commodity and Lanes Anticipated - end of each day)

	Day One (25%)*	Day Two (50%)*	Day Three (100%)*	Commodity Trucks Day 1-3 Total	Within Hurricane Force Winds Population	Households
NHC Forecast Track						
Louisiana	27	54	108	189	1,351,000	511,000
Mississippi	19	37	74	130	926,000	348,000
Alabama	1	3	6	10	73,000	26,000
Total	**47**	**94**	**188**	**329**	**2,350,000**	**885,000**

Key assumption is that establishment of distribution lanes will be the limiting factor.

* Assumption is that States/locals (FL is the * exception) will have the capability to establish about 25% of needed distribution lanes in the first 24 hours post-landfall, about 50% of needed distribution lanes in the first 48 hours after landfall, and all needed lanes by 72 hours post landfall. Florida, due to past experience, estimates they can establish up to 50 distribution lanes per day.

** **Assumption for Katrina** - Assumption is that 40 percent of the resident population will require ice/water due to power outages in areas experiencing hurricane force winds

The amount of water forecasted is based on Mission Guide Book requirements (3 liters per person) and Water SME input and represents a first day daily need. The assumption in this scenario is that 40% of the resident population affected by Katrina will have power outage in this area will cause a need for water.

Details about this model may be obtained at https://englink.usace.army.mil

or contact ENGLink at 1-877-936-4546

US Army Corps of Engineers

Hurricane Katrina Water Model

Generated By:
Terry Siemsen, LRL 0700 EDT 08/29/2005

Sources:
HURREVAC
LRL-DEBRIS